
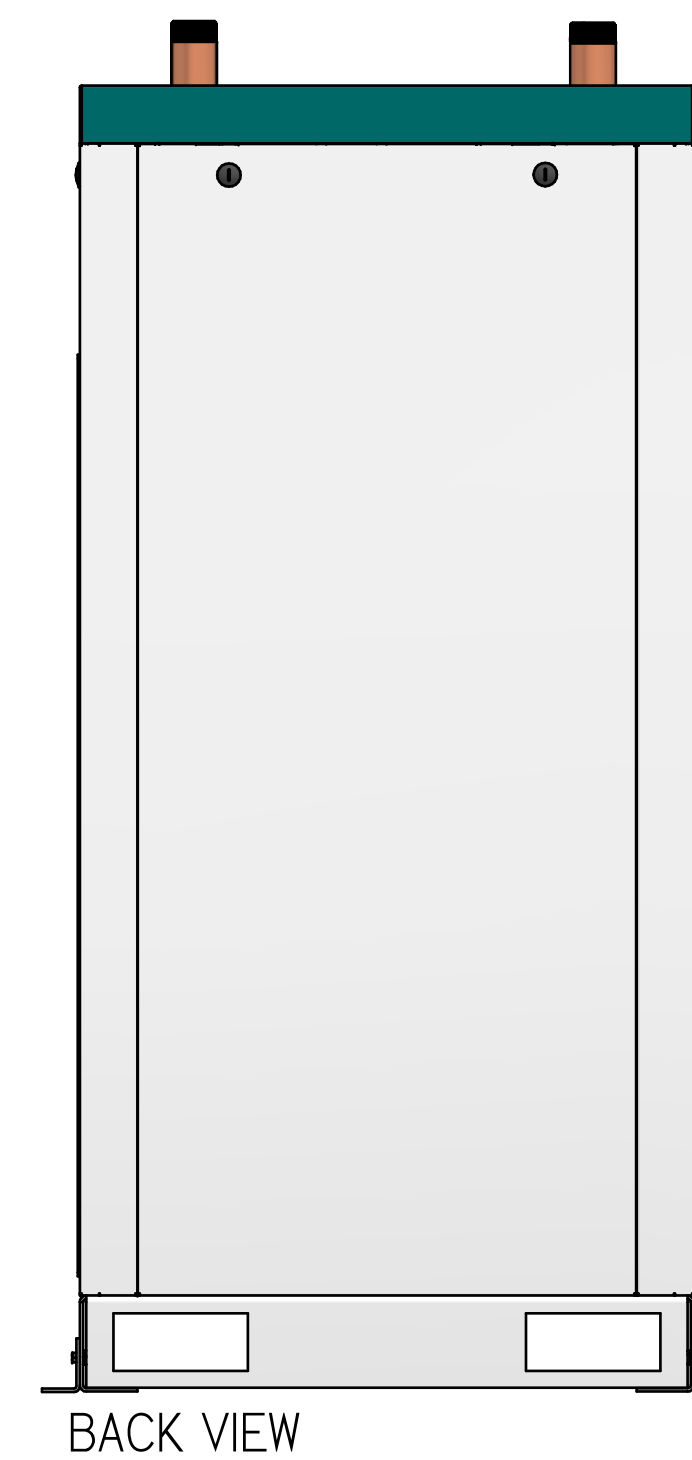
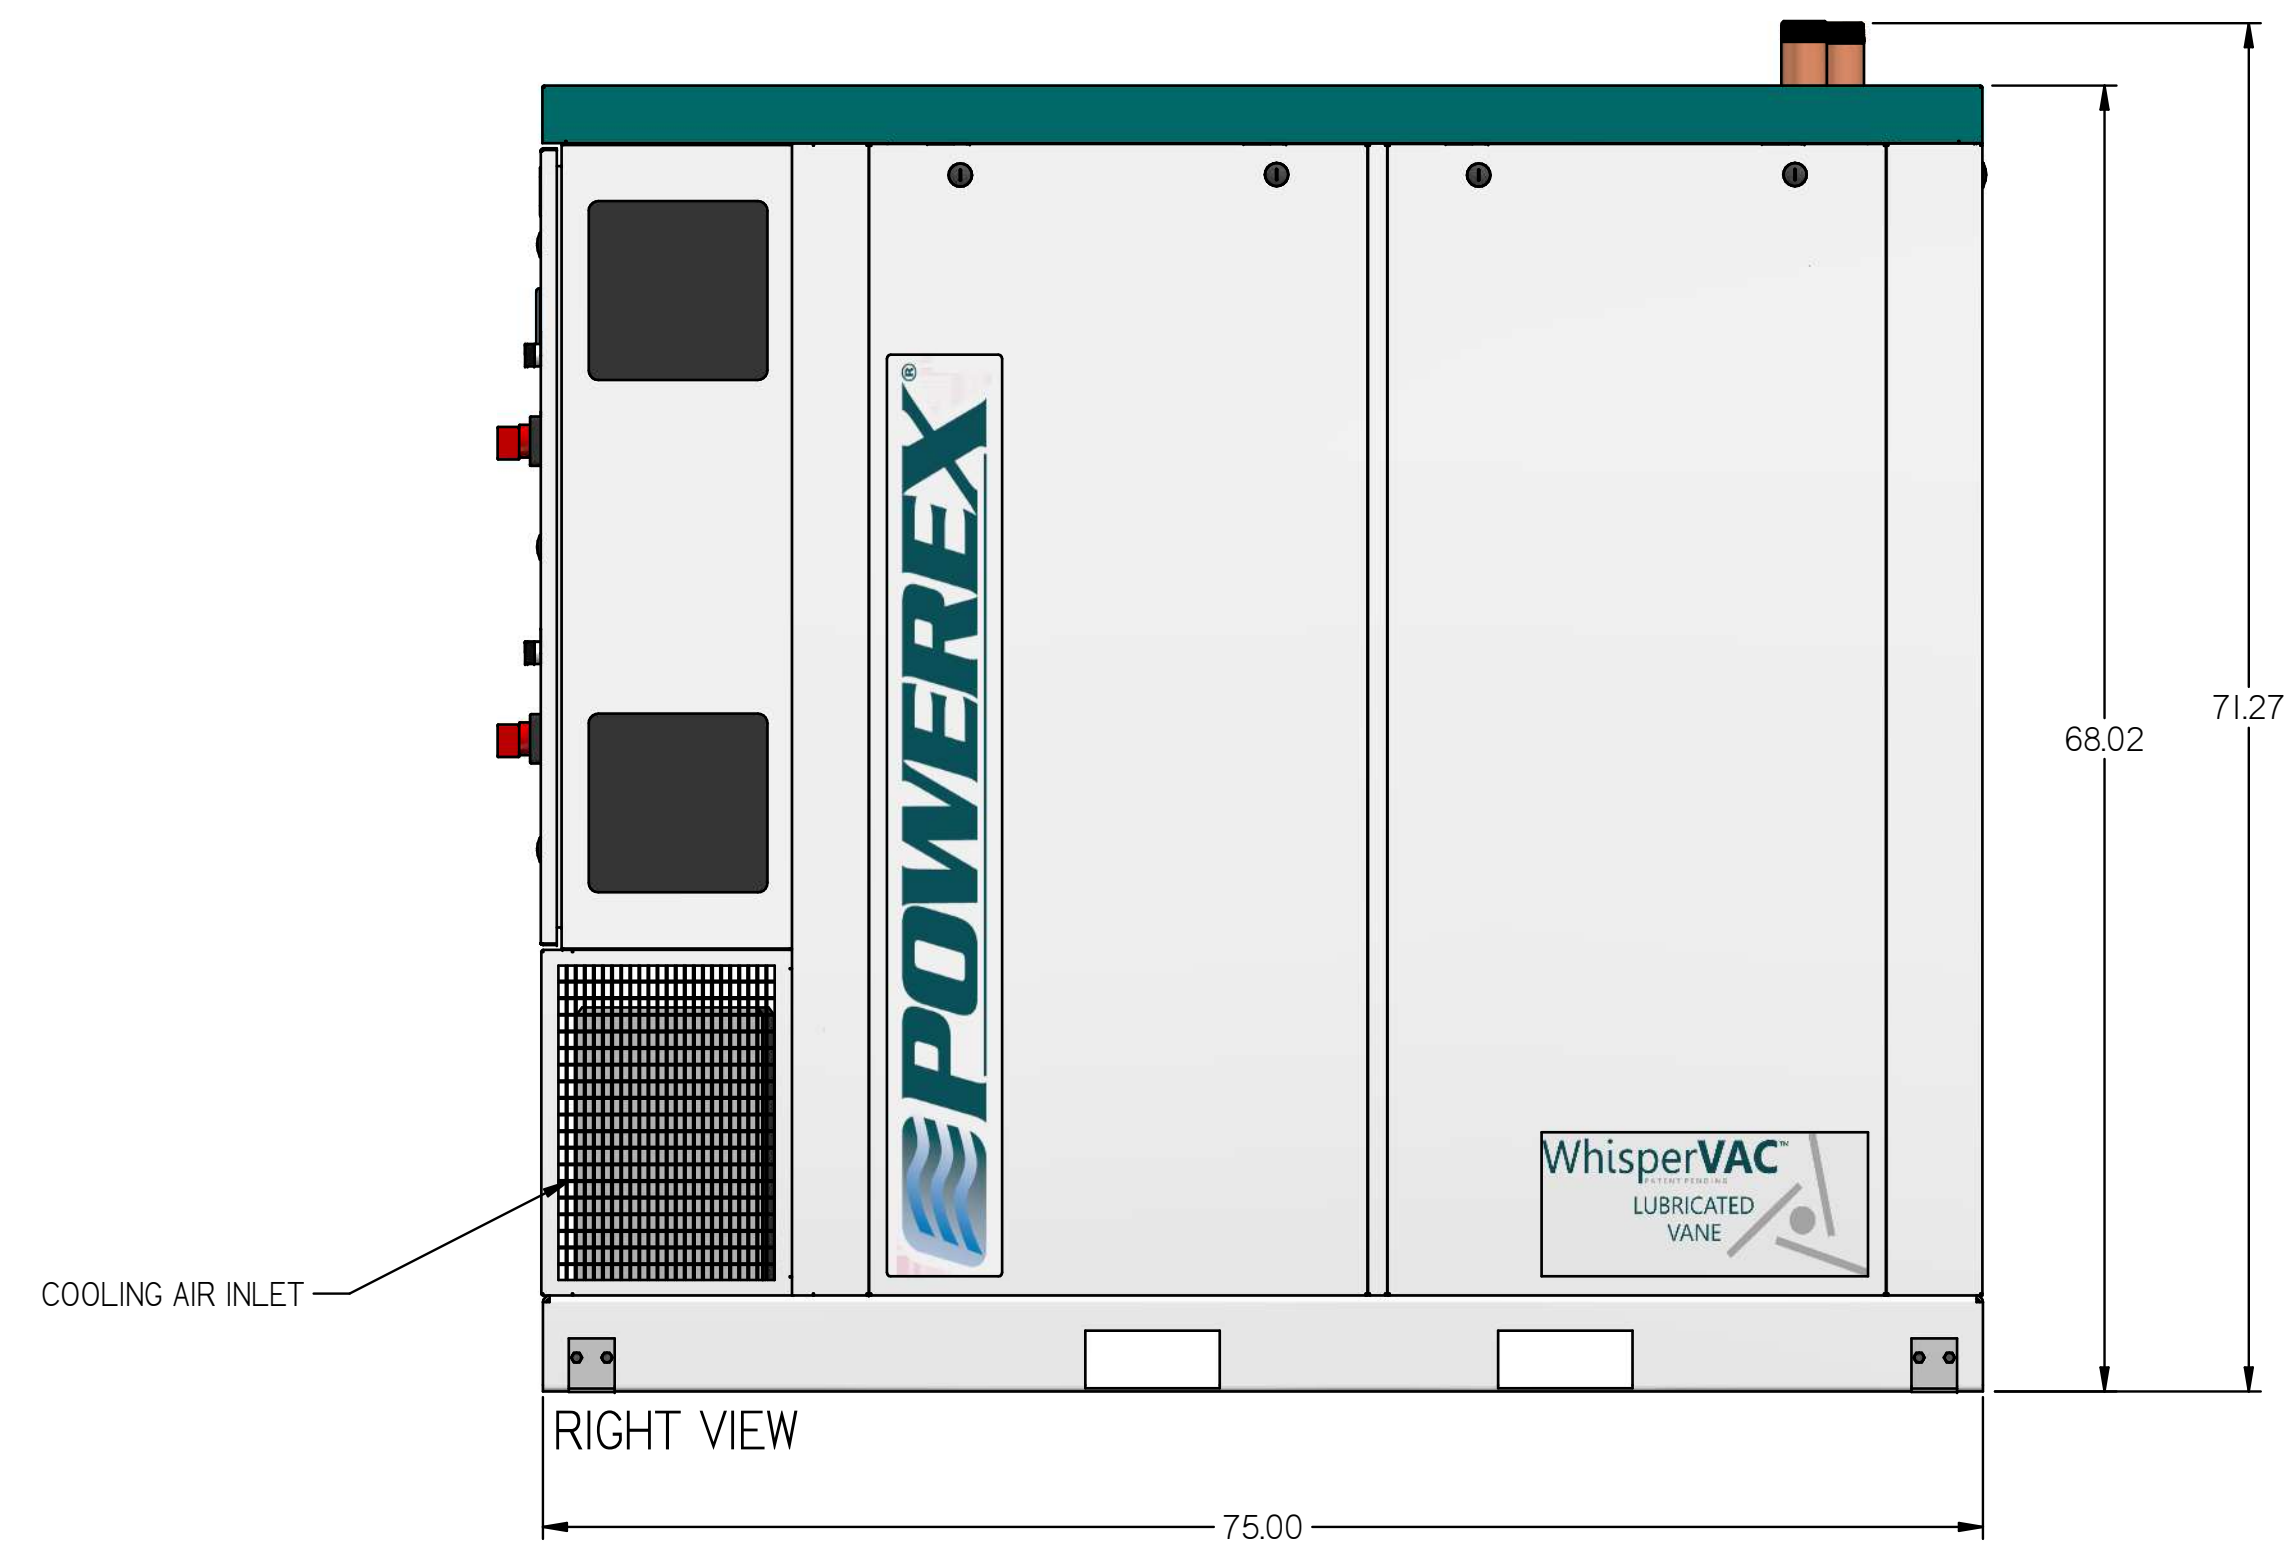
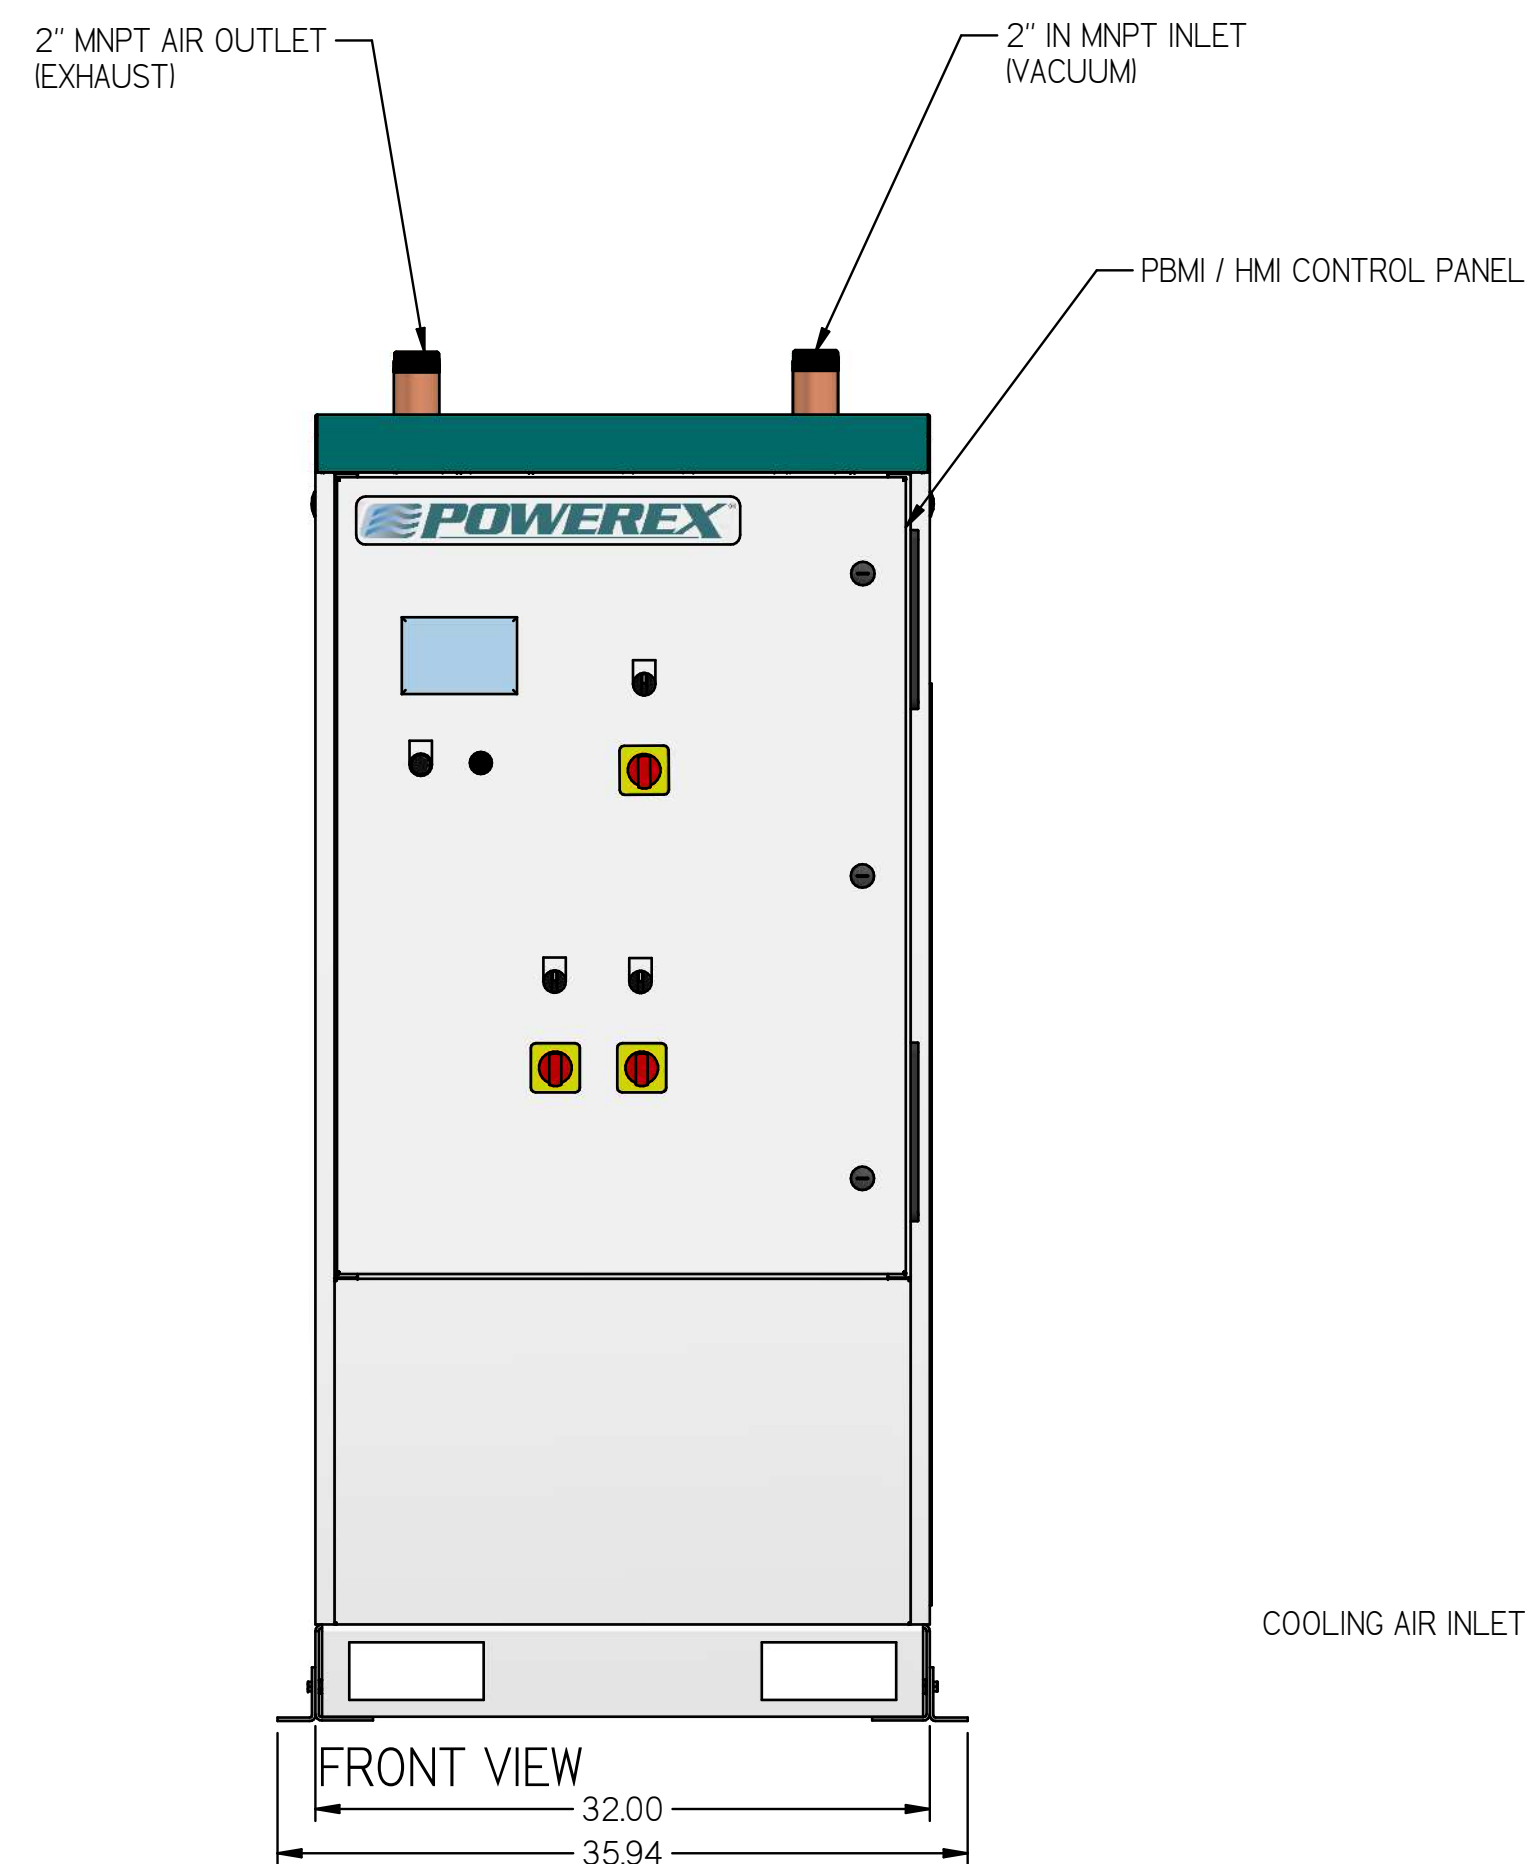
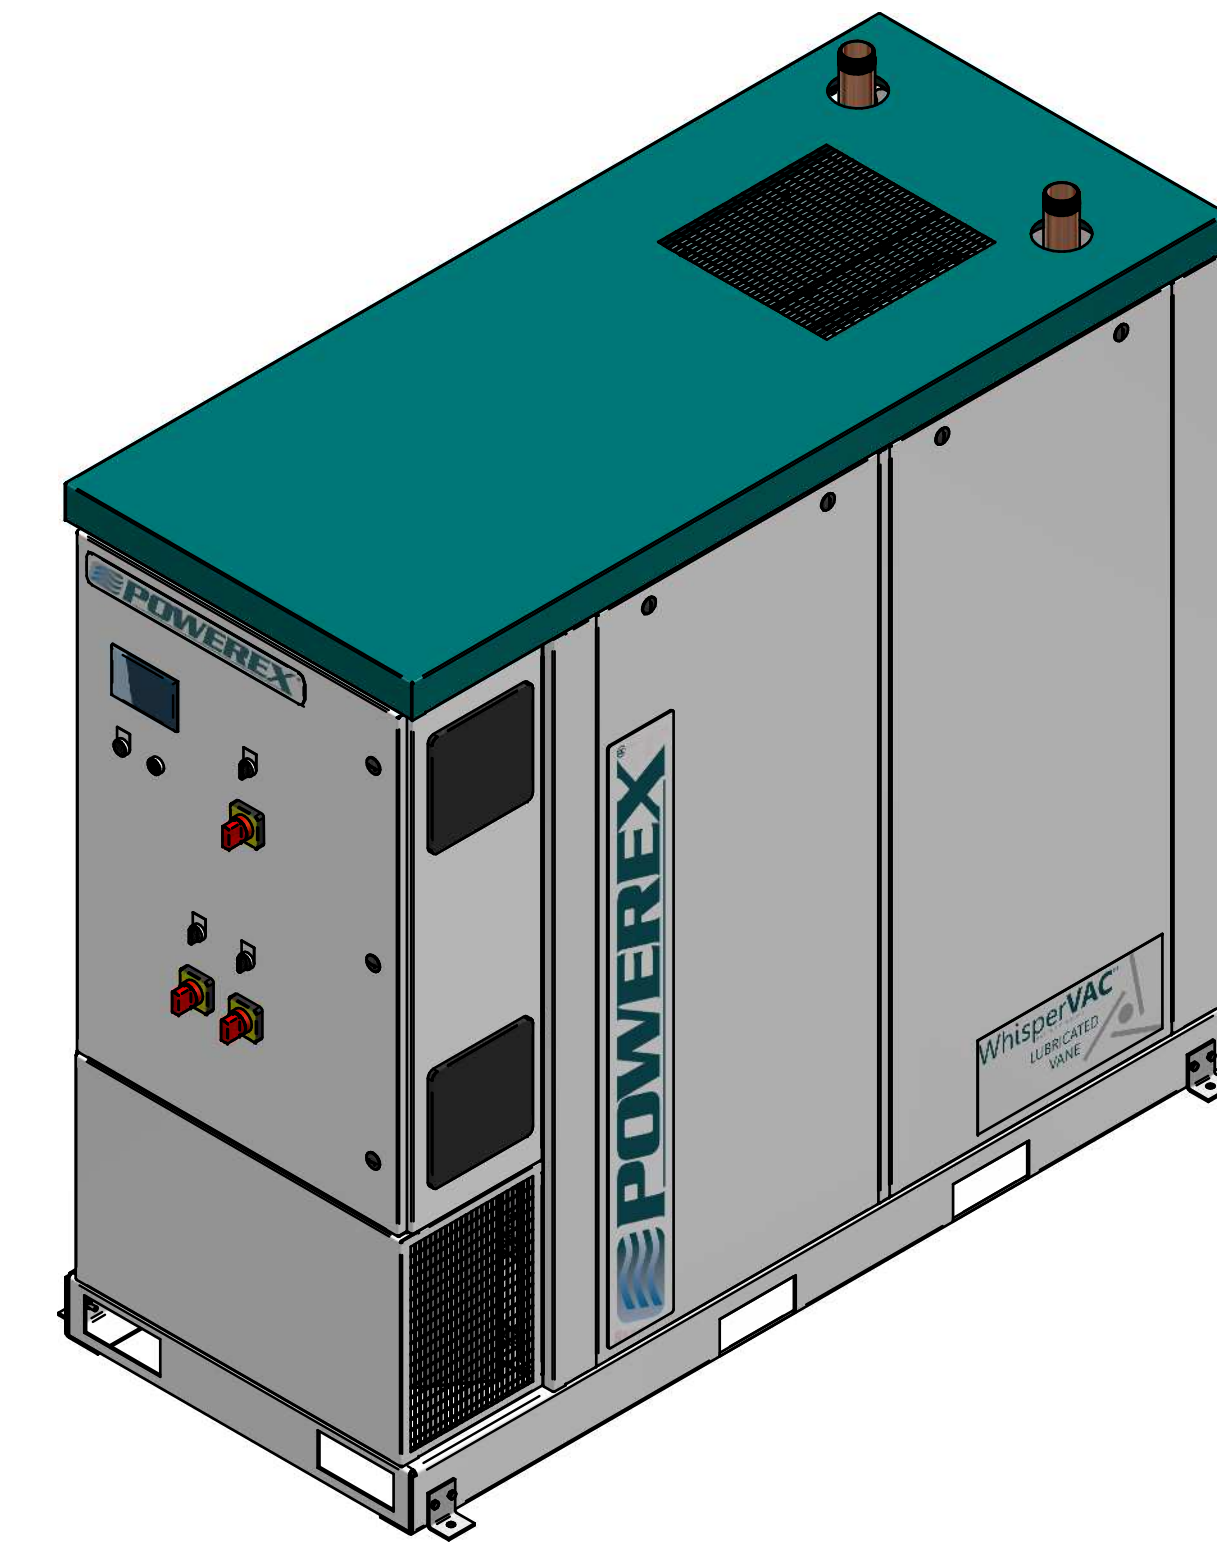


MVED0757

MEDICAL 7.5 HP DUPLEX
VANE VACUUM ENCLOSURE
NO TANK

REVISION NOTES		
DESCRIPTION	ECN	PR/NOR
PRODUCTION RELEASE	PXEC0099	N/A

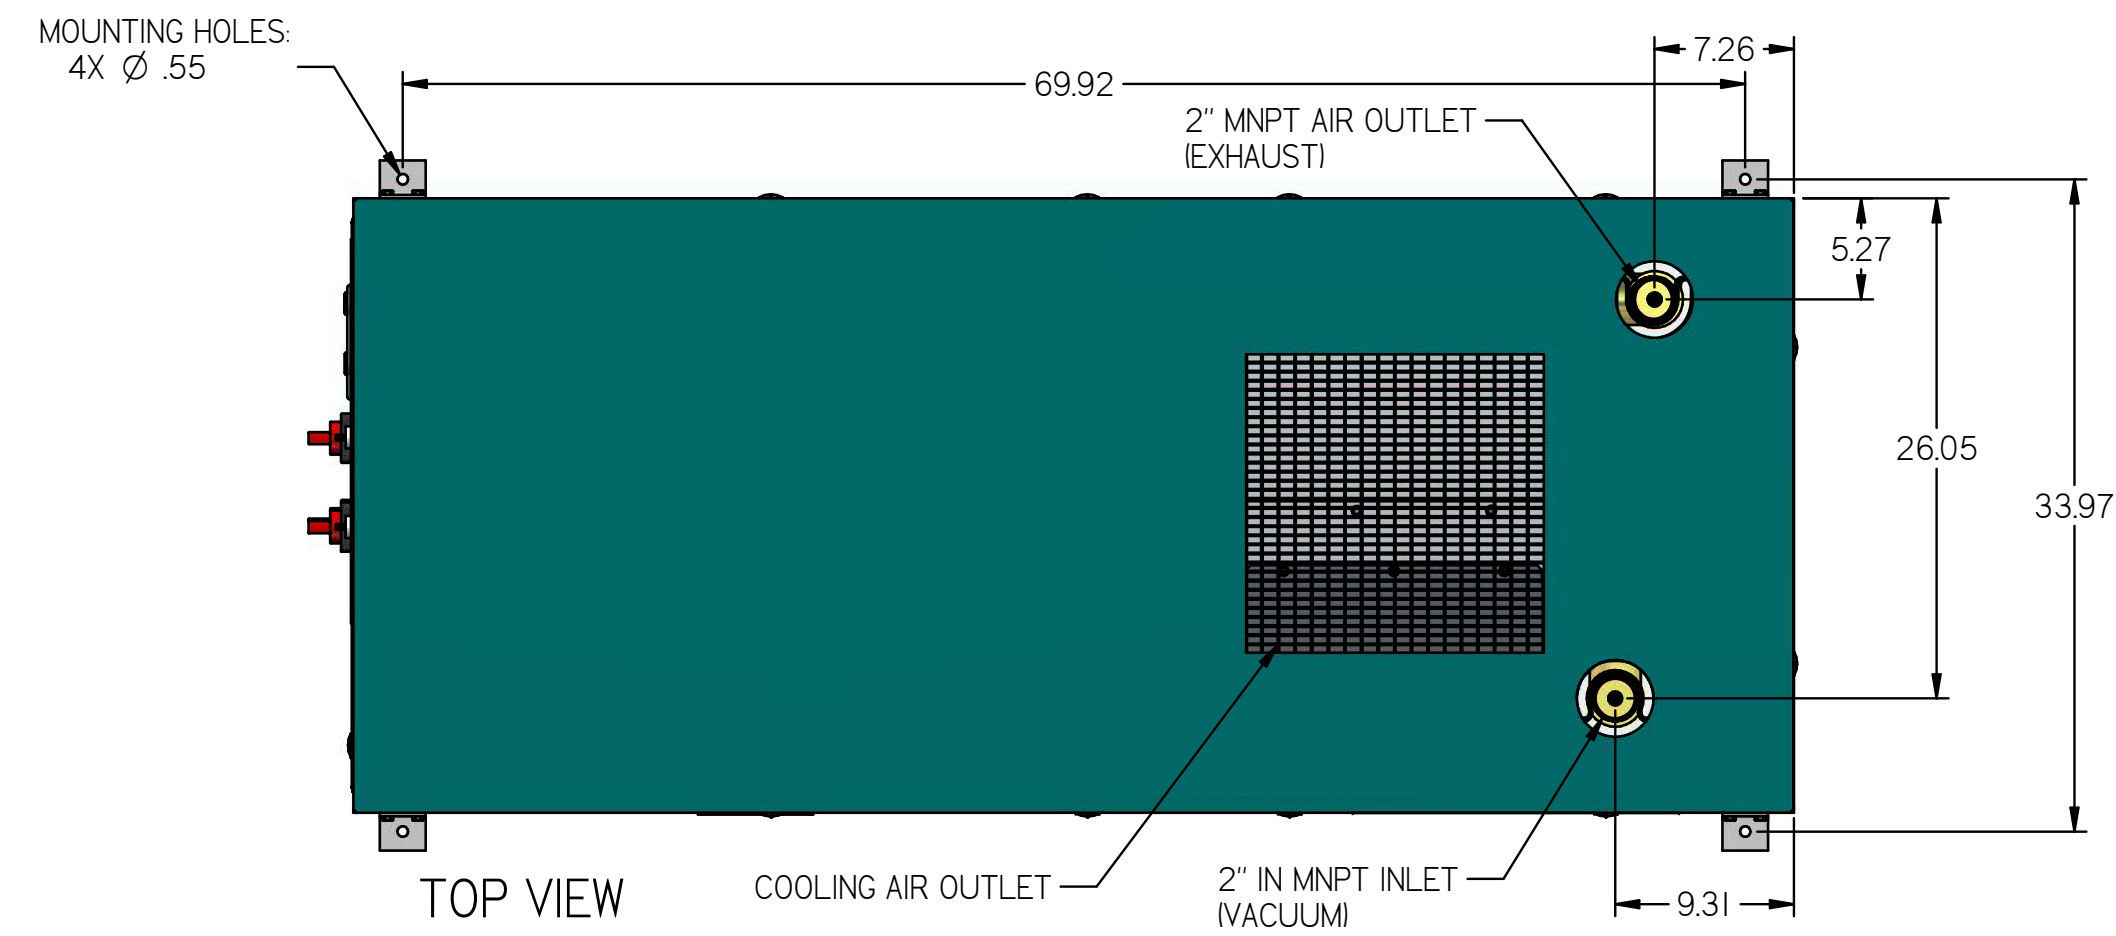

- NOTES:
- APPROX SYSTEM WEIGHT: 1960 LB
 - 24" MINIMUM MAINTENANCE CLEARANCE RECOMMENDED ALL SIDES. CLEARANCE FOR CONTROL PANELS SHALL BE IN ACCORDANCE WITH OSHA/NEC REQUIREMENTS


SYMBOL LEGEND		DRAWINGS TO CONFORM TO CURRENT REVISION OF THE FOLLOWING ANSI STANDARDS:	
TOLERANCES NOT SPECIFIED:	SOLID EDGE DRAWING	DO NOT SCALE DRAWING FOR DIMENSIONS	
Ø .XX ± .05	INCH	SHEET 1 OF 2	SCALE 1:10
Ø .XXX ± .005		APPROVALS ON FILE IN PLM	
<small>CONFIDENTIAL DISCLOSURE</small> This drawing is the property of POWEREX of the SCOTT FETTER COMPANY and is subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or examination.		AUTHOR	ORIGINATION DATE
<small>PROPERTY OF POWEREX</small> 717421 MATERIAL: SEE COMPONENT DRAWINGS DESCRIPTION: MEDICAL 7.5 HP DUPLEX VANE VACUUM ENCLOSURE NO TANK		ASoulek	11/9/2018
DRAWING NUMBER: MVED0757		REVISION: A	SIZE: D

POWEREX

MVED0757

MEDICAL 7.5 HP DUPLEX
VANE VACUUM ENCLOSURE
NO TANK

REVISION NOTES		
DESCRIPTION	ECN	PR/NOR
PRODUCTION RELEASE	PXEC0099	N/A

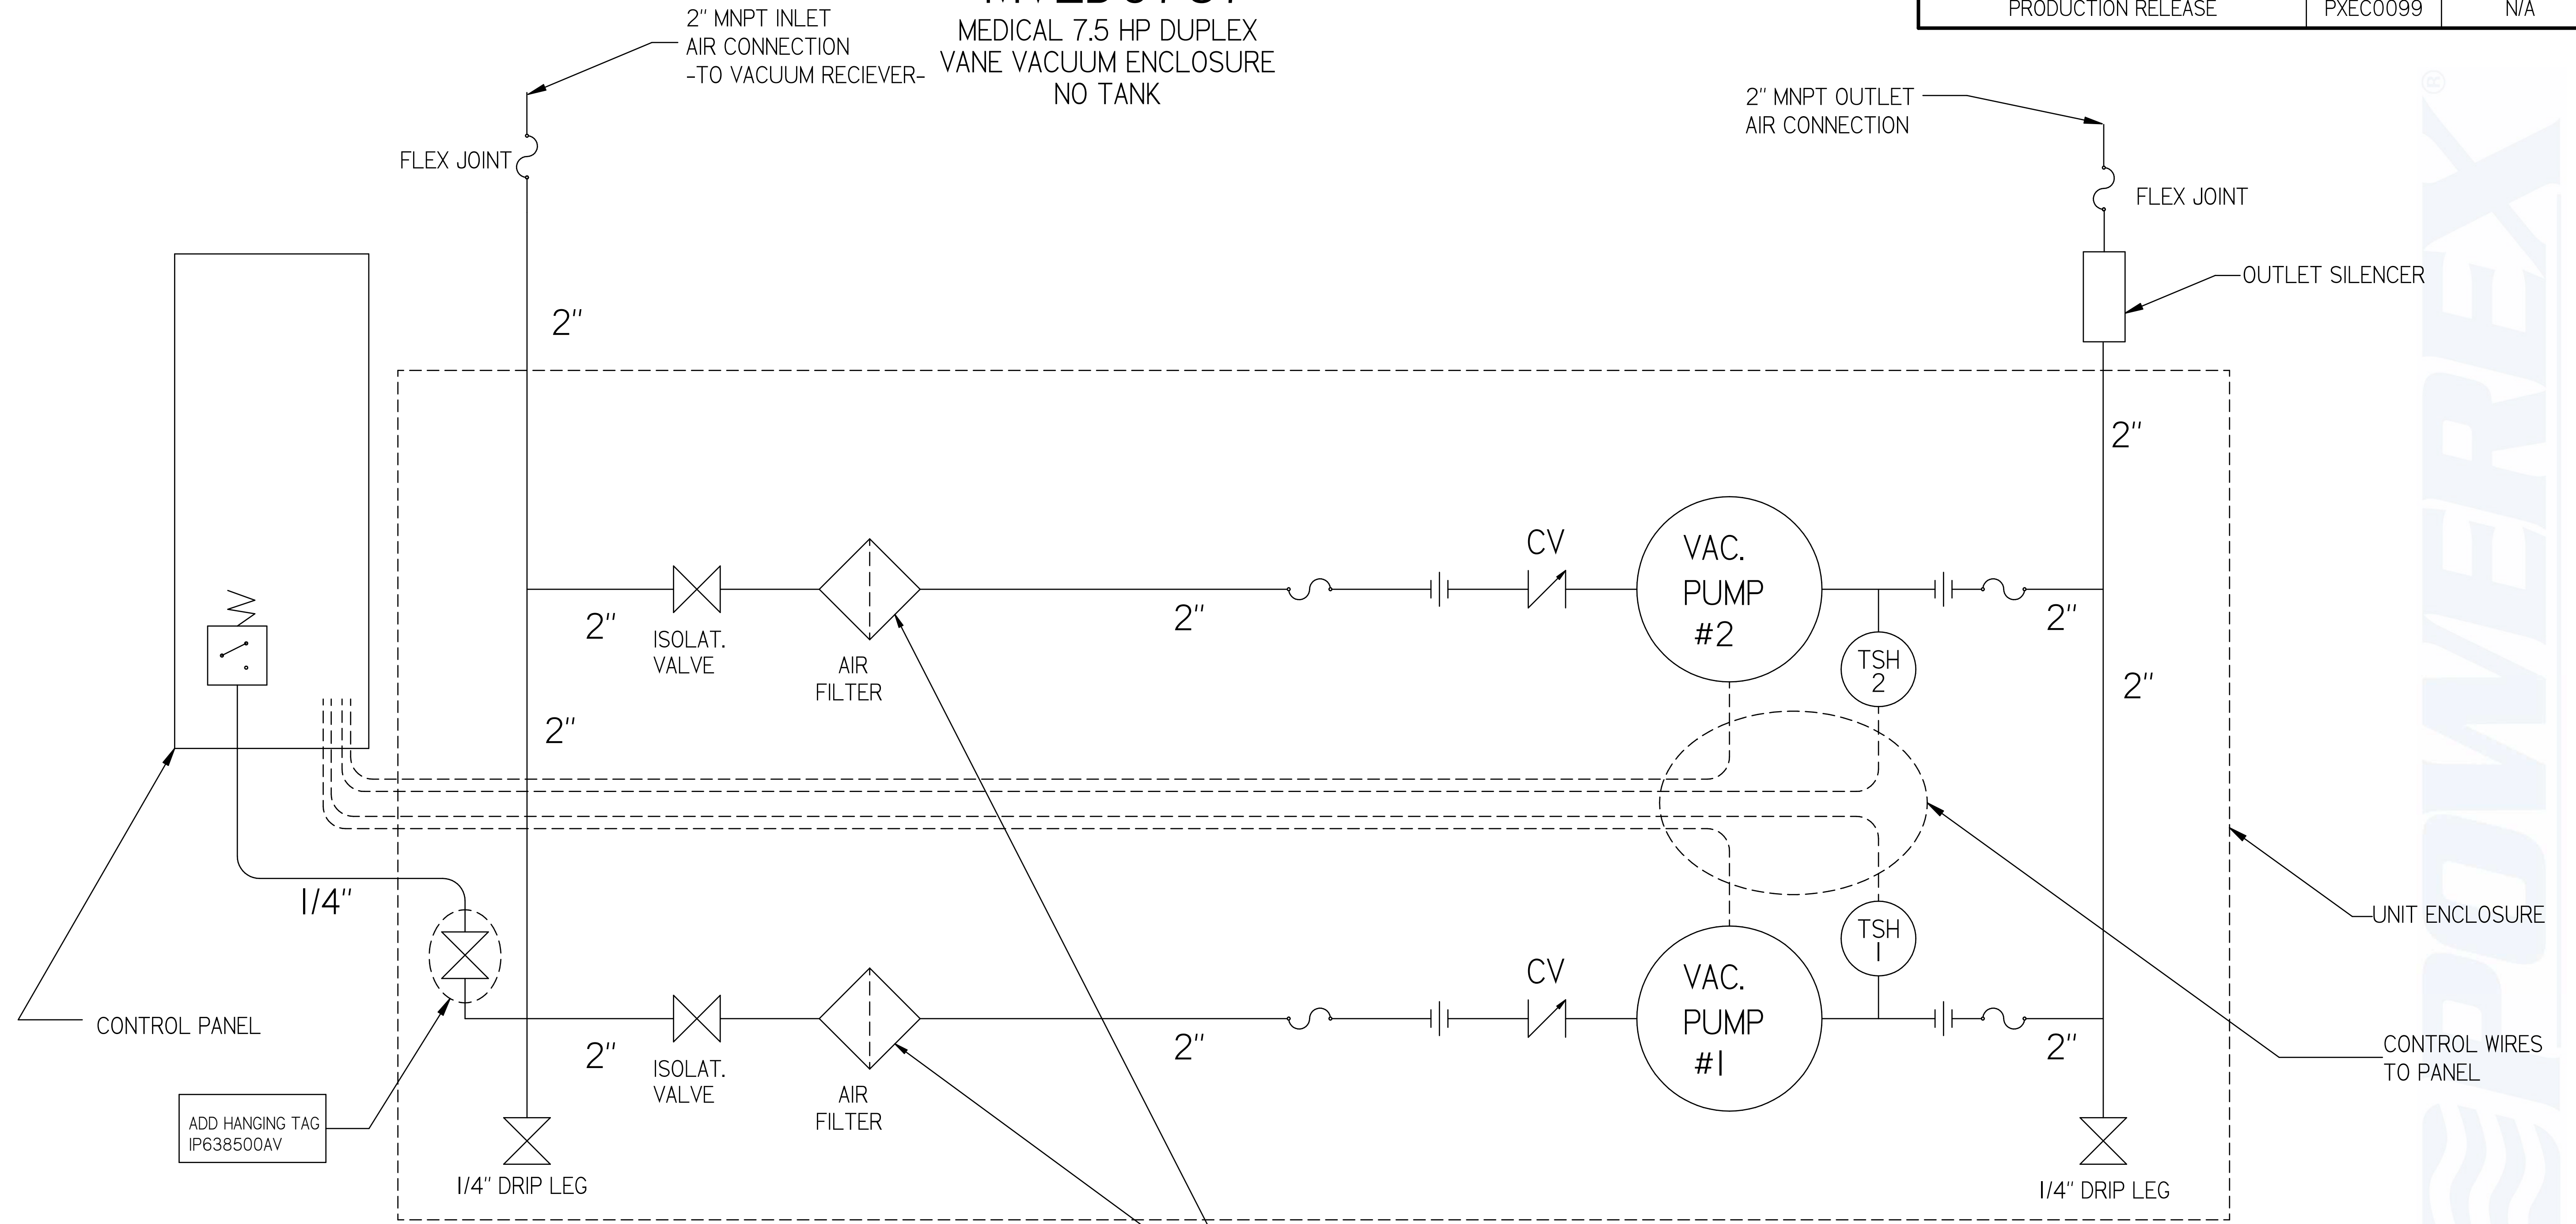

CONTROL PANEL

ADD HANGING TAG
IP638500AV

LEGEND

	TEMP. SWITCH		VACUUM TRANSDUCER
	AIR FILTER		CHECK VALVE
	BALL VALVE		FLEX LINE
			UNION

NOTE:
A 1/4 INCH VENT PLUG IS
LOCATED IN EACH FILTER HOUSING

- NOTES:
1) TSH - TEMPERATURE SWITCH HIGH
2) PER NFPA THE SYSTEM WILL REQUIRE A SOURCE VALVE (SUPPLIED BY OTHERS).
3) OUTLET SILENCER AND FLEX HOSES SHIP LOOSE FOR FIELD INSTALLATION.

SYMBOL LEGEND		DRAWINGS TO CONFORM TO CURRENT REVISION OF THE FOLLOWING ANSI STANDARDS: Y14.3 MULTI AND SECTIONAL VIEW DWGS Y14.5 DIMENSIONING AND TOLERANCING	
TOLERANCES NOT SPECIFIED:	SOLID EDGE DRAWING	DO NOT SCALE DRAWING FOR DIMENSIONS	
0.001 ± .005	INCH	SHEET 2 OF 2	SCALE 1:1
0.002 ± .005			
CONFIDENTIAL DISCLOSURE This drawing is the property of POWEREX of the SCOTT FETTER COMPANY and is subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or examination.		AUTHOR	APPROVALS ON FILE IN PLM
DRAWING NUMBER: 717421		ASoulek	11/9/2018
MATERIAL: SEE COMPONENT DRAWINGS			
DESCRIPTION: MEDICAL 7.5 HP DUPLEX VANE VACUUM ENCLOSURE NO TANK		DRAWING NUMBER: MVED0757	REVISION: A D