
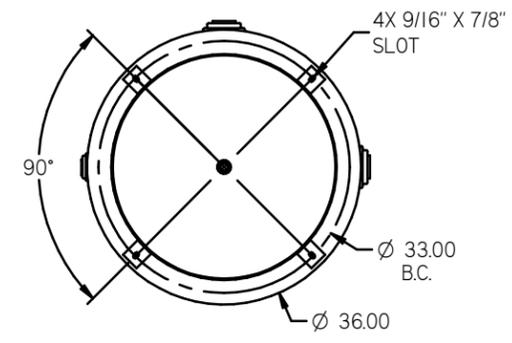


REV	ZONE	REVISION	DATE	ECN	NAME	CHKD
B-1	ALL	RELEASE TO PRODUCTION	10/2017		RK	JA
B-2	ALL	ADDED OUTLET SEPARATOR ADDED LINK TO TANK NOTE CHANGED TO NANO DRIVERS CORRECTED FLOOR PLAN CORRECTED FLOW SCHEMATIC	2/2017		PREC0180	GES
C	ALL	CHANGED TO TROJENT DRIVERS UPDATED TO TC	4/24/19		PREC0229	GES



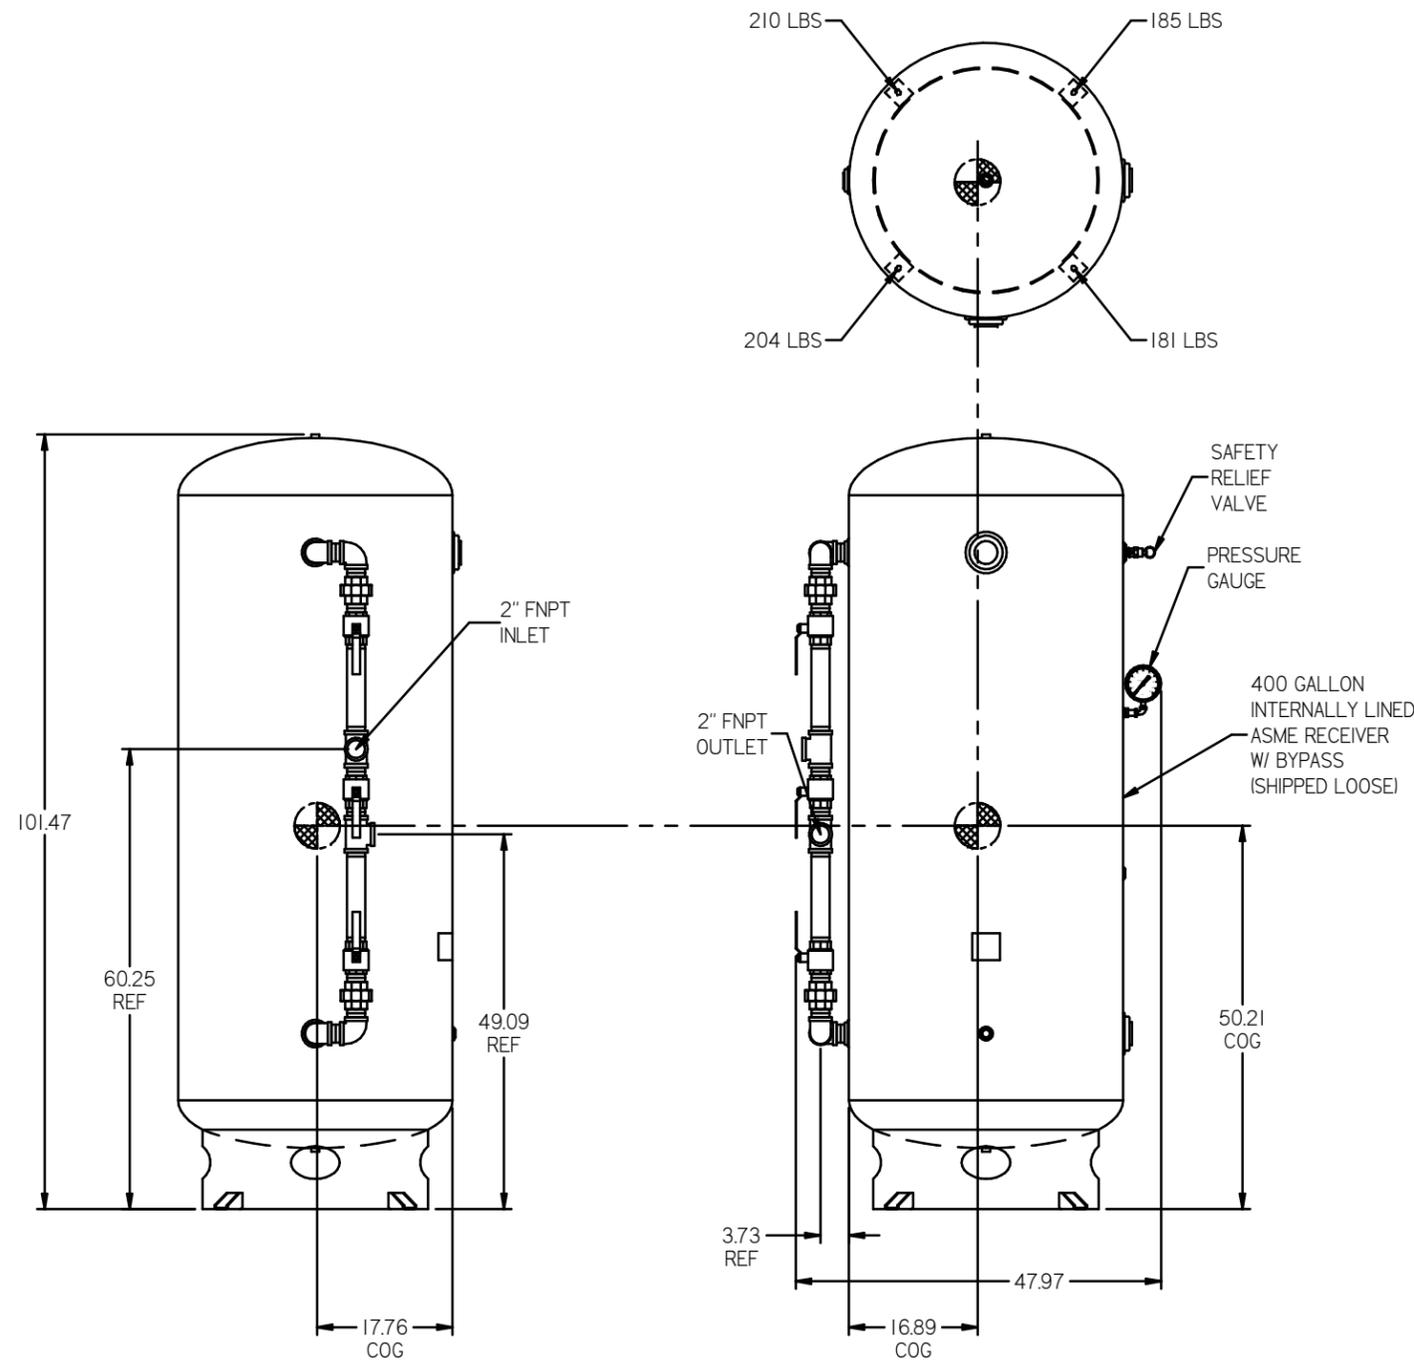


- NOTES:
- SHEET 1 - SCROLL ENCLOSURE LAYOUT
 - SHEET 2 - RECEIVER LAYOUT
 - SHEET 3 - AIR TREATMENT LAYOUT
 - SHEET 4 - PLAN VIEW
 - SHEET 5 - FLOW SCHEMATIC
 - INLET CONNECTIONS: 2" FNPT X 8.
 - OUTLET CONNECTION: 2-1/2" FNPT X 1.
 - POWER CONNECTION : EACH ENCLOSURE: 1- 230, OR 460 VOLT. : ALTERNATION PANEL: 115V
 - WHEN PACKAGE IS INSTALLED INTO THE FACILITY, VERIFY THE INSTALLER REFERENCES TABLE 110.26 (A) (I) FOR MINIMUM WORKING AREA.
 - DIRECTION OF THE INTAKE CONNECTIONS MAY BE MODIFIED AT INSTALLATION BY ADJUSTING THE PIPE THREAD CONNECTIONS.

INDICATES CENTER OF GRAVITY
RECEIVER WEIGHT - 780 LBS

TOLERANCES NOT SPECIFIED XX ± XXX ± (DEG) ±	AUTOCAD LT 2014 INCH	DO NOT SCALE DRAWING FOR DIMENSIONS Sheet 2 of 5 SCALE 1:12
CONFIDENTIAL - DISCLOSE This drawing is the property of POWEREX, INC. of the SCOTT PETER COMPANY and subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or reproduction.	DRAWN BY RK	CHECKED BY JA
MATERIAL N/A	APPROVED BY ENGINEERING MFG/MKTS JA	DATE 12/8/16
PART NAME MEDICAL SCROLL 40HP QUADPLEX	 150 PRODUCTION DRIVE, HARRISBURG, PA 17112 PH: 800-769-7979 FAX: 717-637-3125	SIZE D


REV	ZONE	REVISION	DATE	ECN	NAME	CHKD
B-1	ALL	RELEASE TO PRODUCT ID#	2/2/16	PREC080	RK	JA
B-2	ALL	ADDED OUTLET SEPARATOR ADDED LINING TO TANK NOTE CHANGED TO NANO DRYERS CORRECTED FLOOR PLAN CORRECTED FLOW SCHEMATIC	2/2/17	PREC080	GES	JA
C	ALL	CHANGED TO TROJENT DRYERS, UPDATED TO TC	4/24/19	PREC028	GES	MH

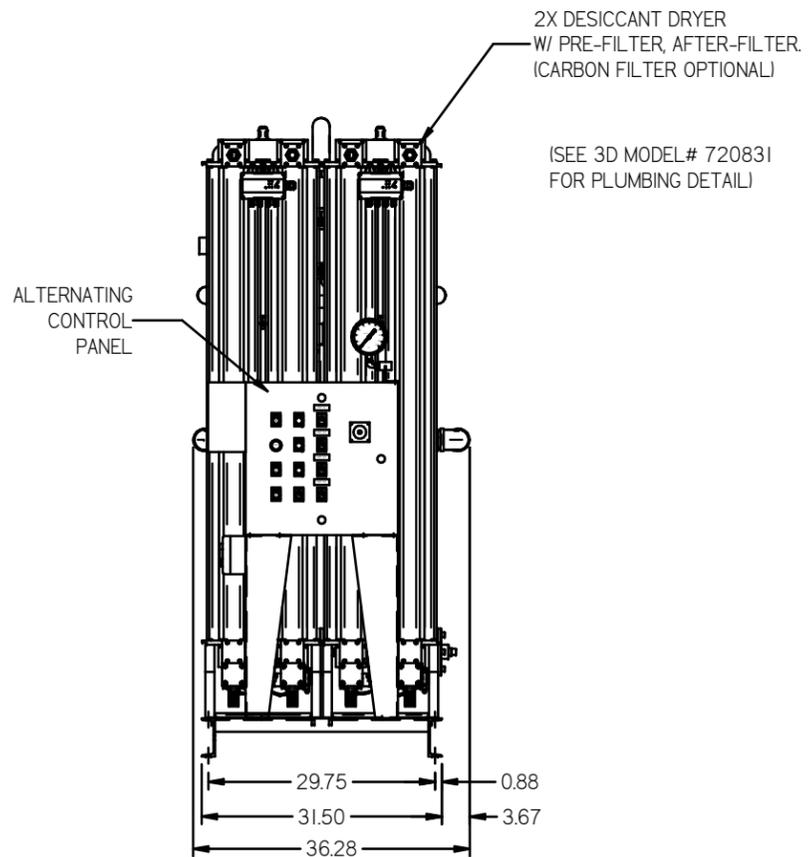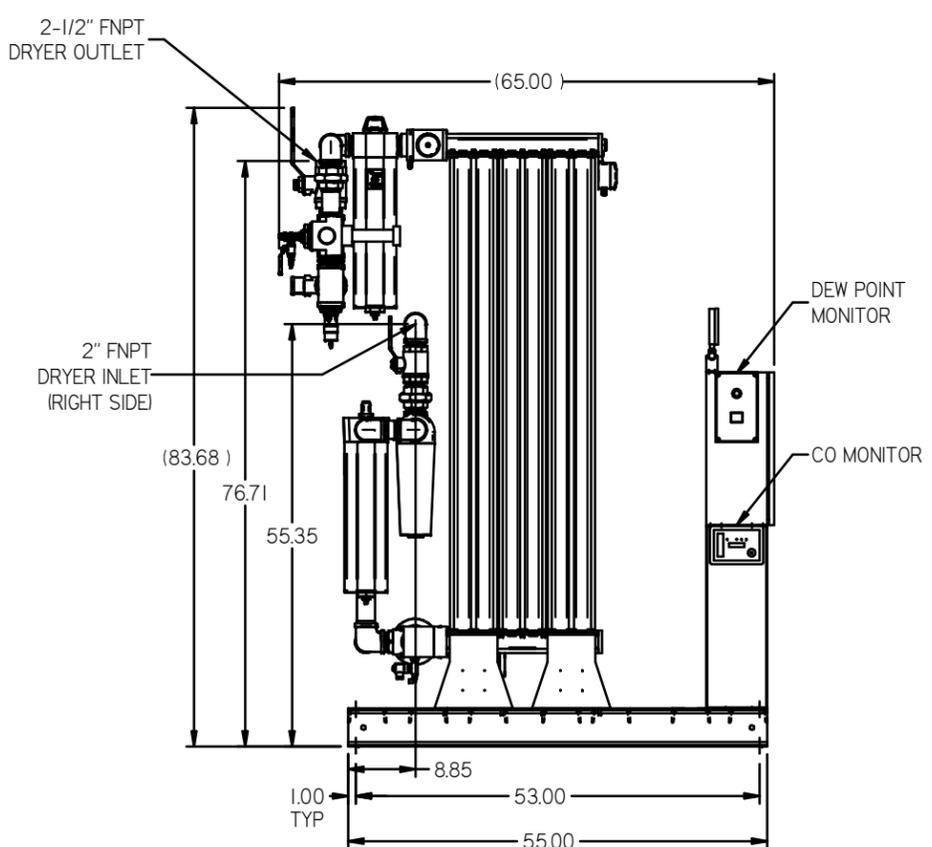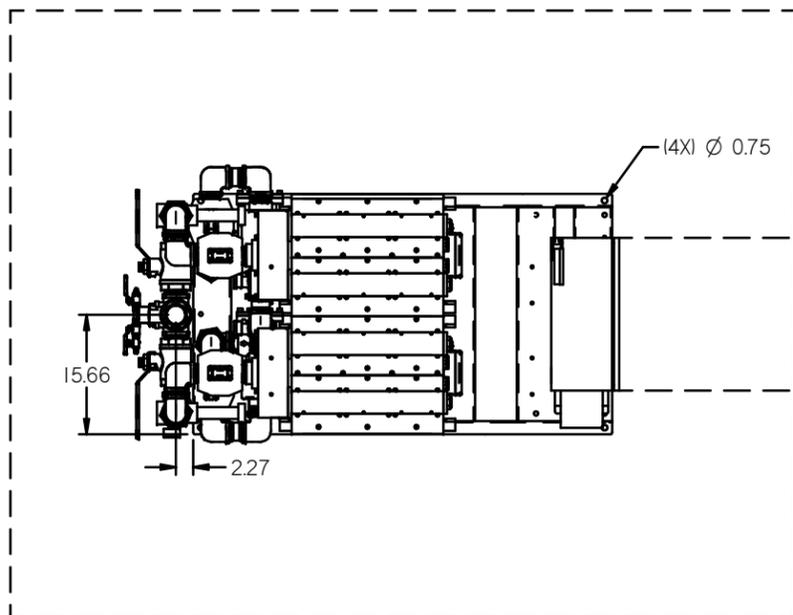

- NOTES:
- 1) SHEET 1 - SCROLL ENCLOSURE LAYOUT
SHEET 2 - RECEIVER LAYOUT
SHEET 3 - AIR TREATMENT LAYOUT
SHEET 4 - PLAN VIEW
SHEET 5 - FLOW SCHEMATIC
 - 2) INLET CONNECTIONS: 2" FNPT X 8.
 - 3) OUTLET CONNECTION: 2-1/2" FNPT X 1.
 - 4) POWER CONNECTION : EACH ENCLOSURE: 1- 230, OR 460 VOLT.
: ALTERNATION PANEL: 115V
 - 5) WHEN PACKAGE IS INSTALLED INTO THE FACILITY, VERIFY THE INSTALLER REFERENCES TABLE 110.26 (A) (I) FOR MINIMUM WORKING AREA.
 - 6) DIRECTION OF THE INTAKE CONNECTIONS MAY BE MODIFIED AT INSTALLATION BY ADJUSTING THE PIPE THREAD CONNECTIONS.

TOLERANCES NOT SPECIFIED XX ± XXX ± DEG ±	= MINUS DRAFT = PLUS DRAFT	= ADDITIONAL CONTROL REQ'D = BRINELL HARDNESS	Drawings to conform to the current revision of the following ANSI standards: Y14.3 Multi and sectional view dwg Y14.5M Dimensioning and tolerancing
AUTOCAD LT 2014 INCH		DO NOT SCALE DRAWING FOR DIMENSIONS Sheet 3 of 5 SCALE 1:12	
CONFIDENTIAL DISCLOSURE This drawing is the property of POWEREX, Inc. of the SOCIET PÉTROLE COMPANY and subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or examination.		DRAWN BY: RK 12/8/16	CHECKED BY: JA 12/8/16
MATERIAL: N/A PART NAME: MEDICAL SCROLL 40HP QUADPLEX		 127 Housatonic Blvd., Suite 400 P.O. Box 759-7979 Fax: (513) 367-3125	
DWG NO: MSEQ40B7		SIZE: D	



REV	ZONE	REVISION	DATE	ECH	NAME	CHD
B-1	ALL	RELEASED TO PRODUCT DEV				
B-2	4/LL	ADDED OUTLET SEPARATOR ADDED LING TO TANK NOTE CHANGED TO HAND DRYERS CORRECTED FLOOR PLAN CORRECTED FLOW SCHEMATIC	2/2/17	PREC080	GES	JA
C	ALL	CHANGED TO TRIDENT DRIVERS, UPDATED TO TC	4/24/19	PREC029H	GES	MH

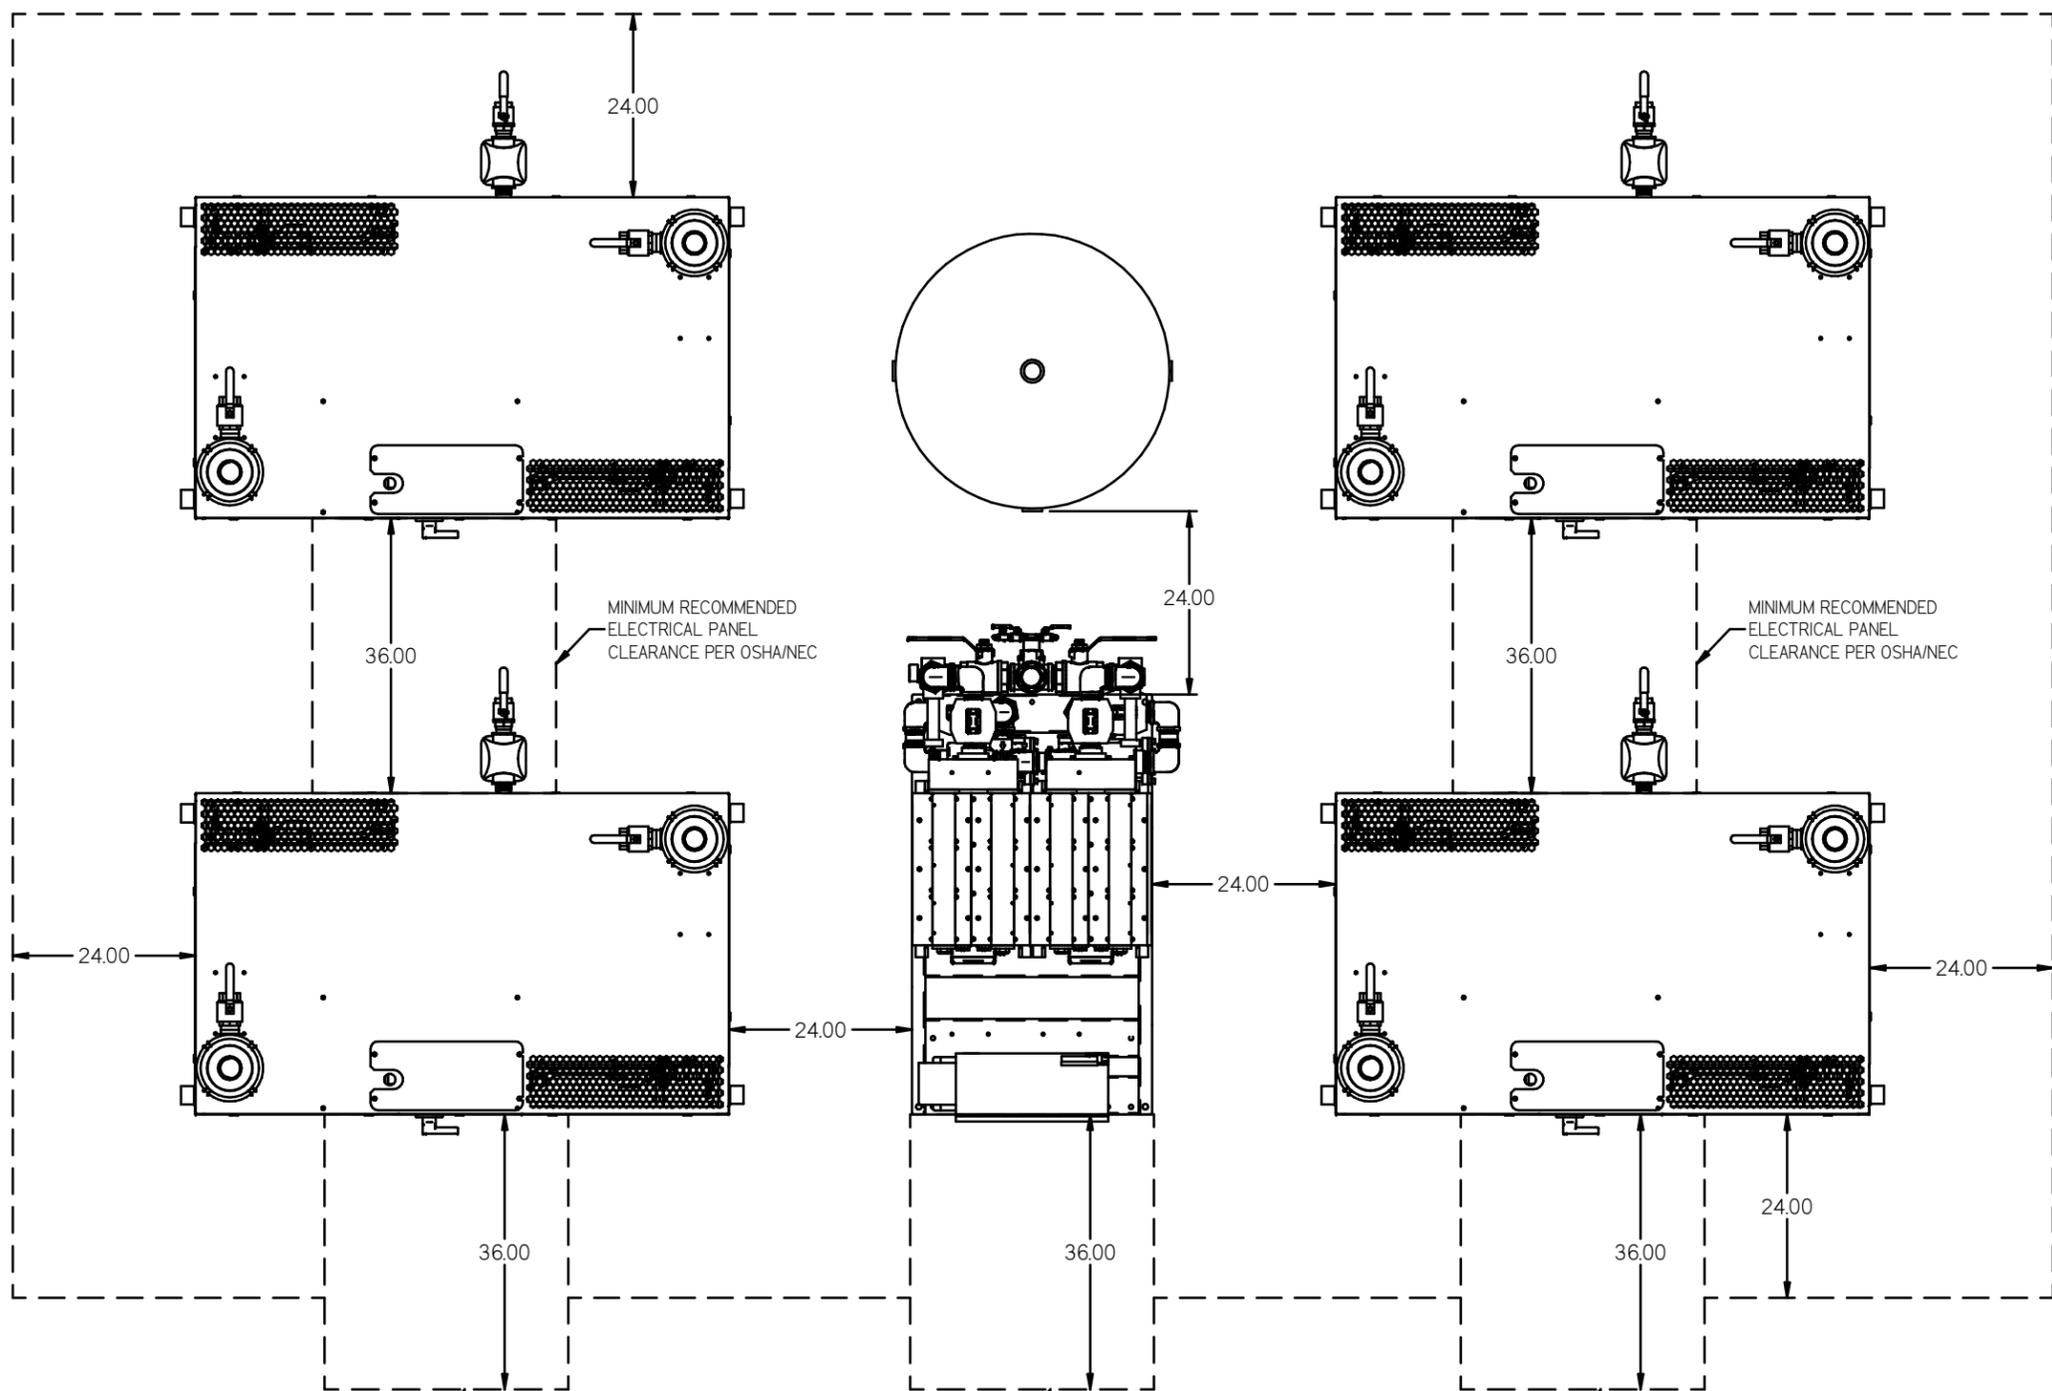

- NOTES:
- SHEET 1 - SCROLL ENCLOSURE LAYOUT
SHEET 2 - RECEIVER LAYOUT
SHEET 3 - AIR TREATMENT LAYOUT
SHEET 4 - PLAN VIEW
SHEET 5 - FLOW SCHEMATIC
 - INLET CONNECTIONS: 2" FNPT X 8.
 - OUTLET CONNECTION: 2-1/2" FNPT X 1.
 - POWER CONNECTION : EACH ENCLOSURE: 1- 230, OR 460 VOLT.
: ALTERNATION PANEL: 115V
 - WHEN PACKAGE IS INSTALLED INTO THE FACILITY,
VERIFY THE INSTALLER REFERENCES
TABLE 110.26 (A) (1) FOR MINIMUM WORKING AREA.
 - DIRECTION OF THE INTAKE CONNECTIONS MAY BE MODIFIED
AT INSTALLATION BY ADJUSTING THE PIPE THREAD CONNECTIONS.

<p>SYMBOL LEGEND</p> <p>⊖ = MINUS DRAFT</p> <p>⊕ = PLUS DRAFT</p> <p>⊗ = ADDITIONAL CONTROL REQ'D</p> <p>⊘ = BRINELL HARDNESS</p>	<p>Drawings to conform to the current revision of the following ANSI standards:</p> <p>Y14.3 Multi and sectional view usage</p> <p>Y14.5 Dimensioning and tolerancing</p>
<p>TOLERANCES NOT SPECIFIED</p> <p>XX ±</p> <p>XXX ±</p> <p>4 DEC ±</p>	<p>AUTOCAD Lt 2014</p> <p>DO NOT SCALE DRAWING FOR DIMENSIONS</p> <p>Sheet 4 of 5</p> <p>SCALE 1:12</p>
<p>CONFIDENTIAL DISCLOSURE</p> <p>This drawing is the property of POWEREX, INC. of the SCOTT FETZER COMPANY and subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or examination.</p>	<p>DRWN BY: RK</p> <p>CHECKED BY: JA</p> <p>APPROVED BY: JA CT</p> <p>12/8/16 12/8/16 12/8/16 12/8/16</p>
<p>MATERIAL: N/A</p> <p>PART NAME: MEDICAL SCROLL 40HP QUADPLEX</p>	<p>POWEREX</p> <p>MANUFACTURED AND TESTED TO SPECIFICATIONS</p> <p>DWG NO: MSEQ40B7</p> <p>SIZE: D</p>

REV	ZONE	REVISION	DATE	EDN	NAME	CHKD
B-1	ALL	RELEASE TO PRODUCTION	12/8/16	PRECD00	RK	JA
B-2	ALL	ADDED OUTLET SEPARATOR ADDED LING TO TANK NOTE CHANGED TO HAND DRIVERS CORRECTED FLOOR PLAN CORRECTED FLOW SCHEMATIC	2/2/17	PRECD00	GES	JA
C	ALL	CHANGED TO TRIDENT DRYERS, UPDATED TO TC	4/24/19	PRECD29	GES	MMH

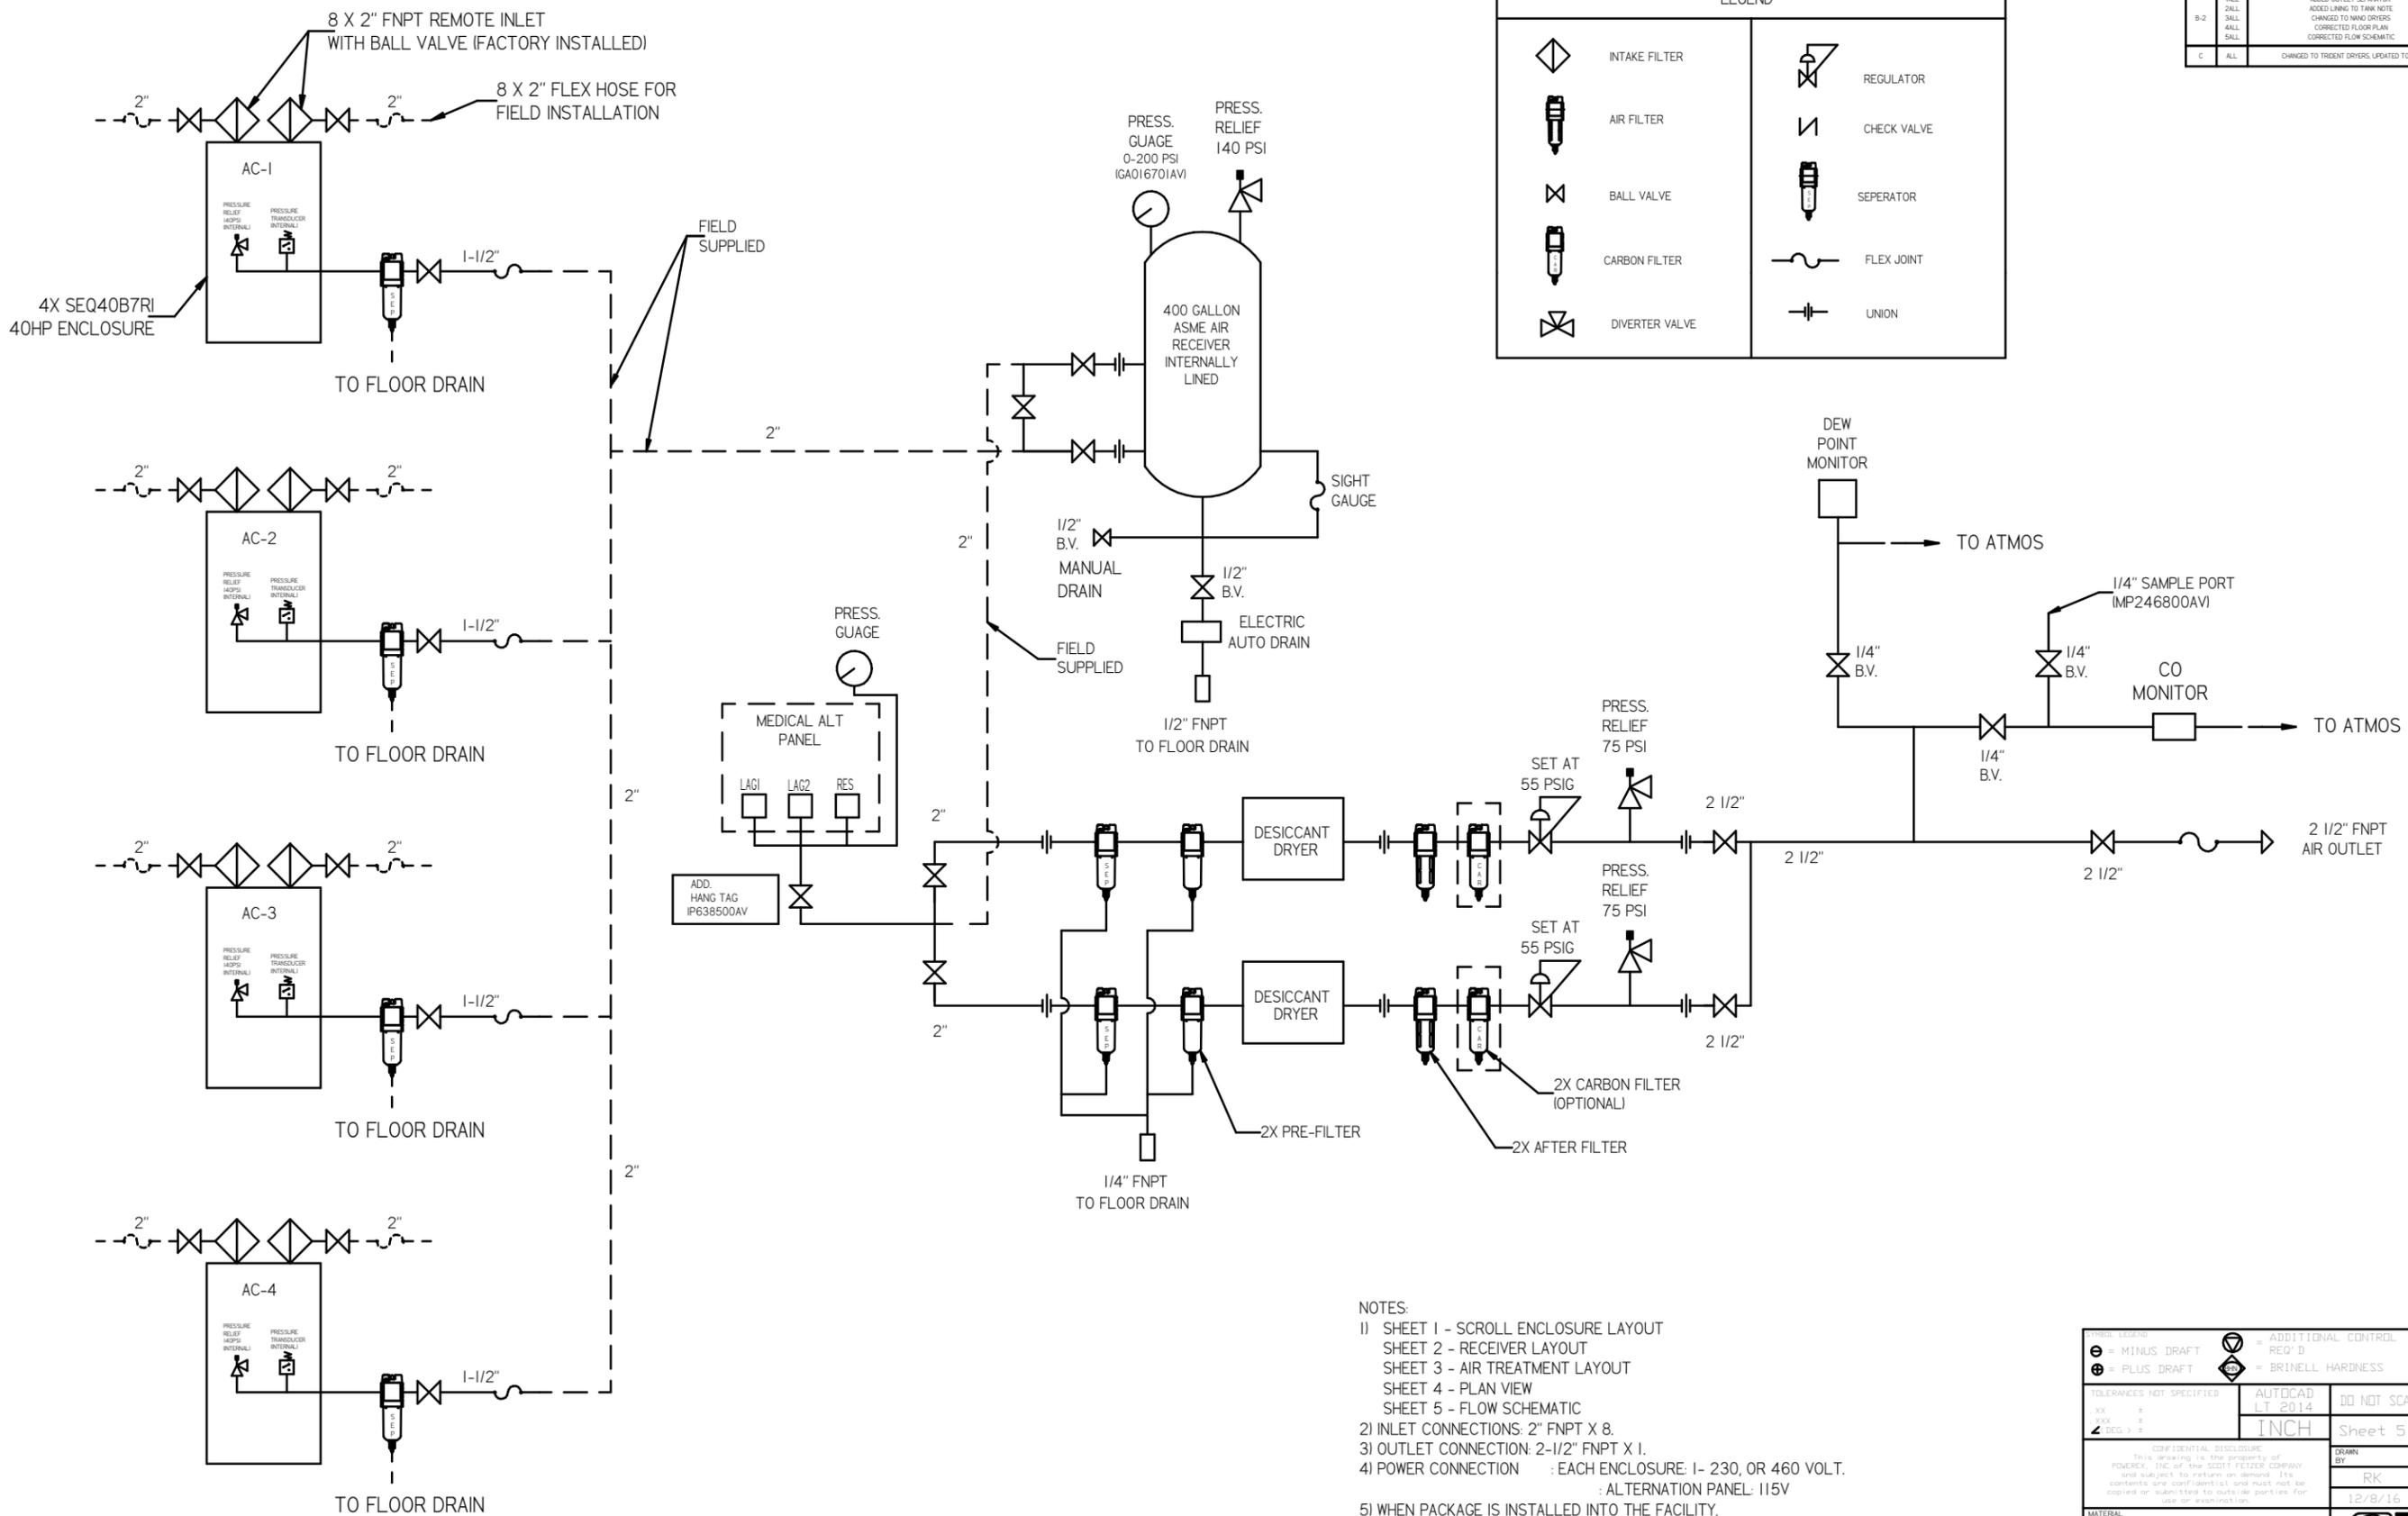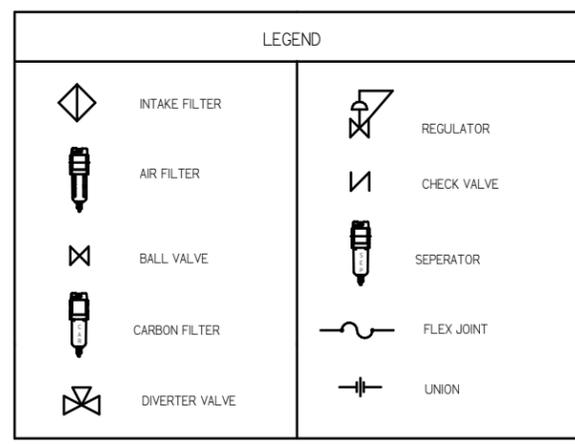

- NOTES:
- SHEET 1 - SCROLL ENCLOSURE LAYOUT
SHEET 2 - RECEIVER LAYOUT
SHEET 3 - AIR TREATMENT LAYOUT
SHEET 4 - PLAN VIEW
SHEET 5 - FLOW SCHEMATIC
 - INLET CONNECTIONS: 2" FNPT X 8.
 - OUTLET CONNECTION: 2-1/2" FNPT X 1.
 - POWER CONNECTION : EACH ENCLOSURE: 1- 230, OR 460 VOLT.
: ALTERNATION PANEL: 115V
 - WHEN PACKAGE IS INSTALLED INTO THE FACILITY, VERIFY THE INSTALLER REFERENCES
TABLE 110.26 (A) (I) FOR MINIMUM WORKING AREA.
 - DIRECTION OF THE INTAKE CONNECTIONS MAY BE MODIFIED AT INSTALLATION BY ADJUSTING THE PIPE THREAD CONNECTIONS.

<p>MINUS DRAFT</p> <p>PLUS DRAFT</p>	<p>ADDITIONAL CONTROL</p> <p>RED'D</p> <p>BRINELL HARDNESS</p>	<p>Drawings to conform to the current revision of the following AWS standards:</p> <p>114.3 Multi and sectional view dsgs</p> <p>114.5B Dimensioning and tolerancing</p>
<p>RESOURCES NOT SPECIFIED</p> <p>XXX</p> <p>REG</p>	<p>AUTOCAD LT 2014</p> <p>INCH</p>	<p>DO NOT SCALE DRAWING FOR DIMENSIONS</p> <p>Sheet 5 of 5</p> <p>SCALE 1:12</p>
<p>CONFIDENTIAL DISCLOSURE</p> <p>This drawing is the property of POWEREX, Inc. or the SCOTT FITZGER COMPANY and subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or dissemination.</p>		
<p>MATERIAL: N/A</p> <p>PART NAME: MEDICAL SCROLL 40HP QUADPLEX</p>	<p>DRWN BY: RK</p> <p>CHECKED BY: JA</p> <p>12/8/16</p>	<p>APPROVED BY: JA, CT</p> <p>12/8/16, 12/8/16, 12/8/16, 12/8/16</p> <p>POWEREX</p> <p>114.5B Dimensioning and tolerancing</p> <p>PH: 888-769-7979 FAX: (513) 367-3125</p>
<p>DWG NO: MSEQ40B7</p>	<p>SIZE: D</p>	