
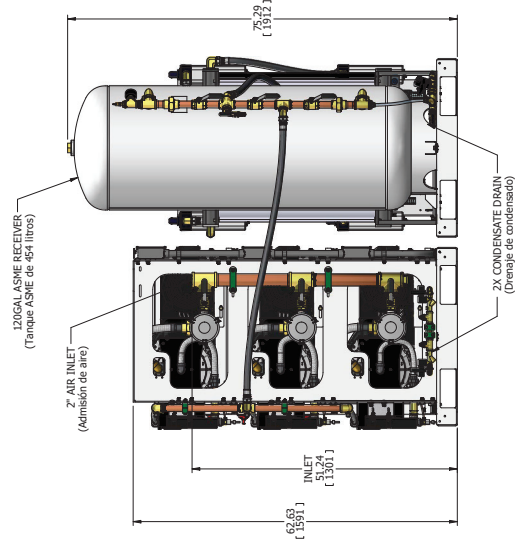
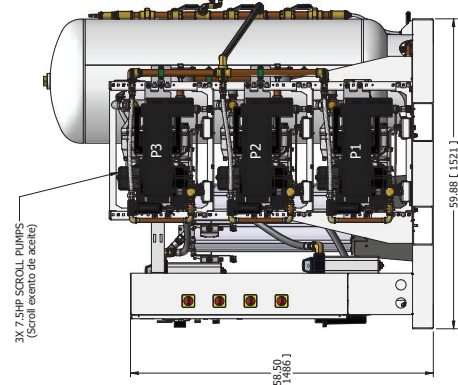
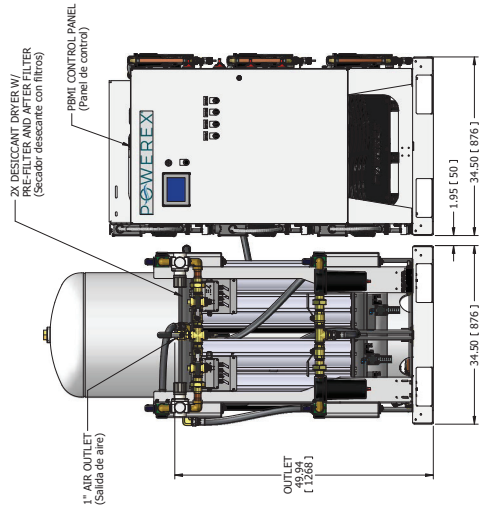
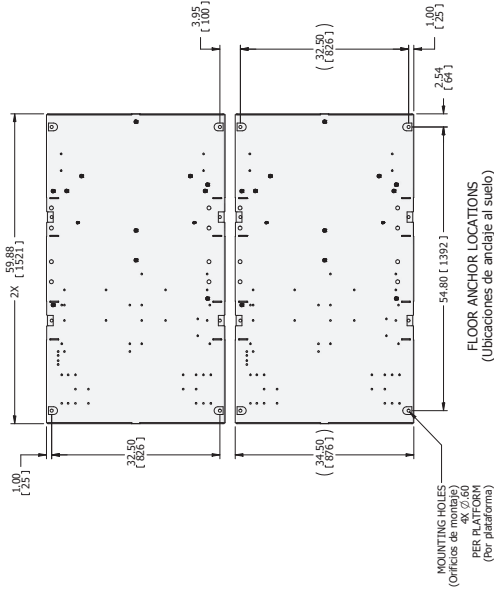


7.5HP LAB OPEN SCROLL TRIPLEX 120GAL DUPLEX DESICCANT

REVISION NOTES		EON
DESCRIPTION		
PRODUCTION RELEASE		PXEC0318

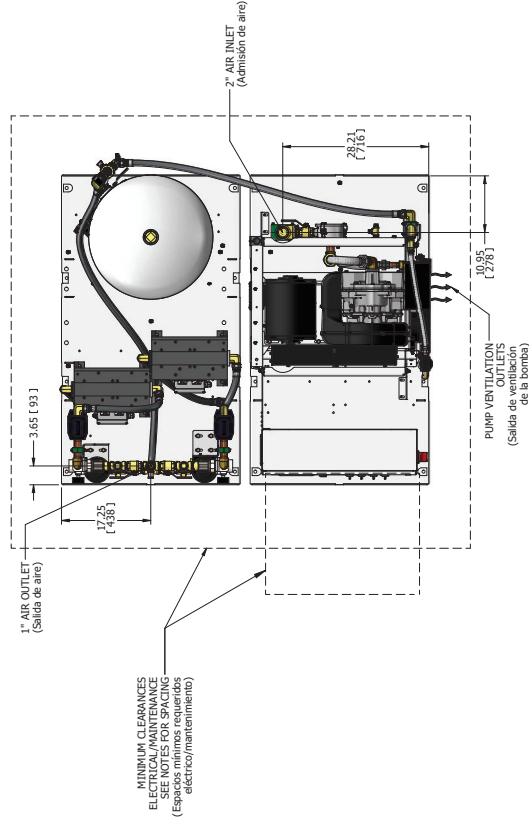


- NOTES:
1. APPROXIMATE WEIGHT: 2410 LBS
2. A MINIMUM OF 24" CLEARANCE IS RECOMMENDED AROUND THE ENTIRE UNIT. CLEARANCE FOR CONTROL PANEL SHALL BE MAINTAINED AT ALL TIMES.
3. SYSTEM DESIGNED IN COMPLIANCE WITH U.S. NFPA 99, LATEST EDITION.
4. INLET AND OUTLET FLEX HOSES ADD 12" TO CONNECTIONS
5. RECOMMEND MAXIMUM FLEX HOSE LENGTH BE 6'.
6. RECOMMENDOS QUE EL ESPACIO LIBRE ALREDEDOR DEL SISTEMA DEBE SER COMO MÍNIMO 24" (600 mm). EL ESPACIO DEBE SER PARA EL TALLERO DE CORTADO DE LA PARED Y PARA LAS CONEXIONES DE LOS REQUERIMIENTOS DE SEGURIDAD DE LA OSHA.
7. EL SISTEMA ESTÁ DISEÑADO DE ACUERDO CON LA ÚLTIMA EDICIÓN DE LA NFPA 99.
8. EL SISTEMA SE HA DISEÑADO PARA ENTRADA Y SALIDA DE AIRE EN UN SENTIDO.

[illegible]

7.5HP LAB OPEN SCROLL TRIPLEX 120GAL DUPLEX DESICCANT

REVISION NOTES		ECN
DESCRIPTION		
PRODUCTION RELEASE	PXEC0318	

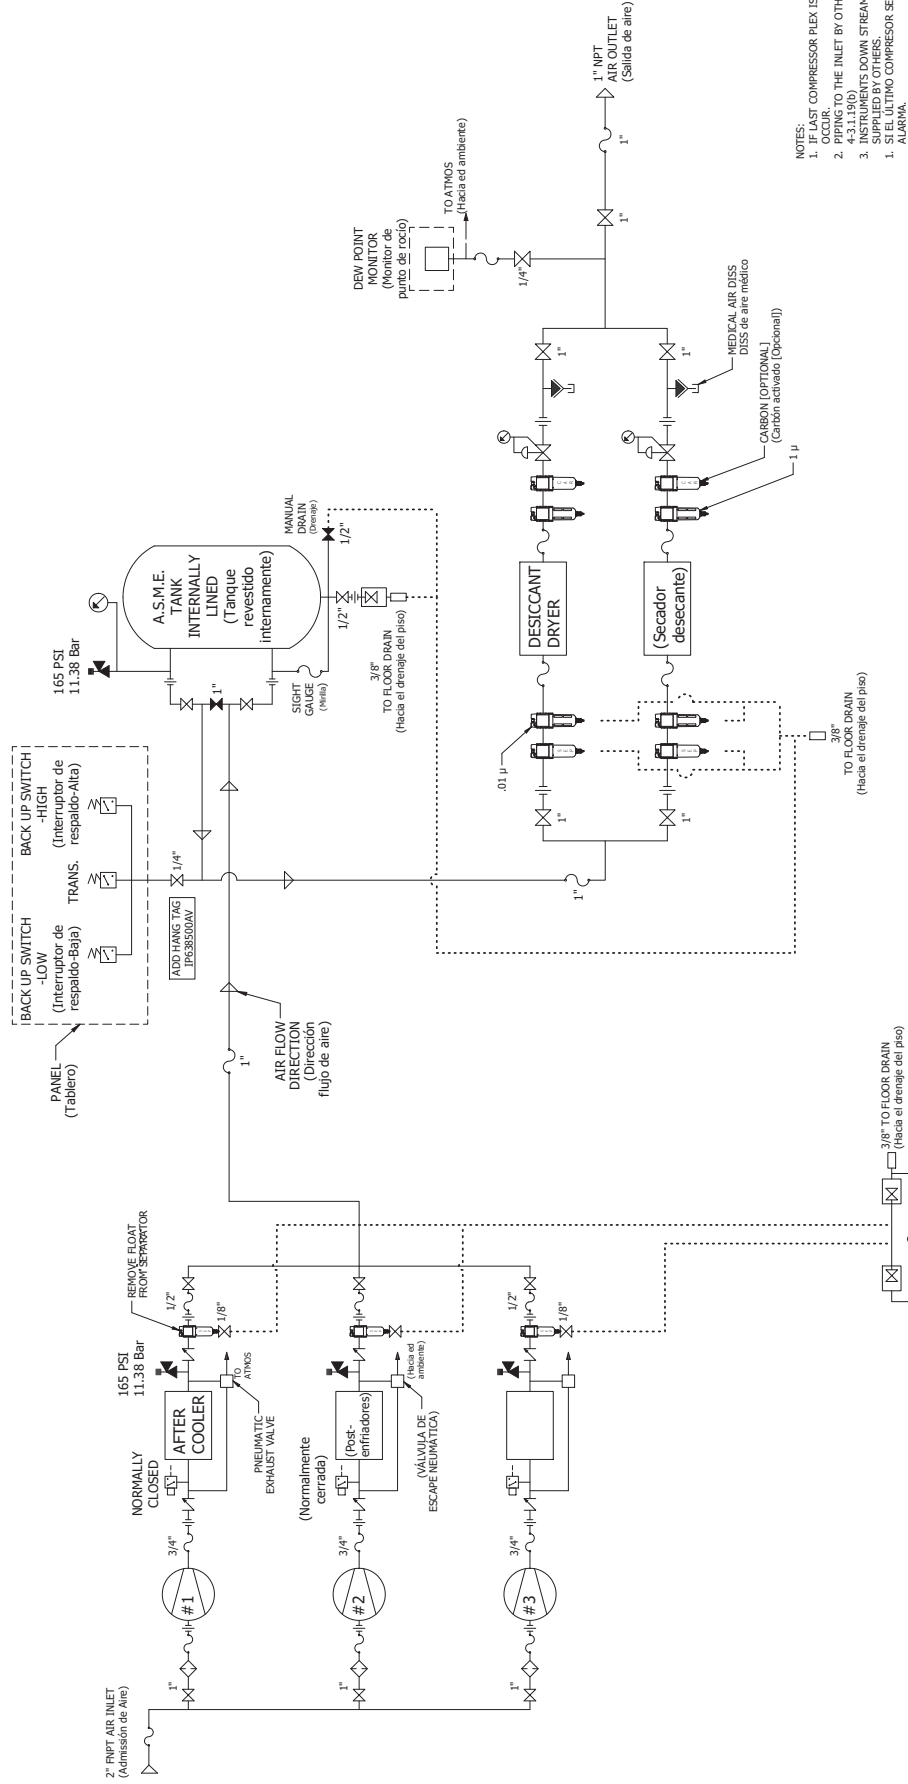

- NOTES:
1. IF LAST COMPRESSOR PLEX IS ENERGIZED ALARM WILL OCCUR.
 2. PIPING TO THE INLET BY OTHERS AND TO PER NFPA99 3.1.1.1 (19)(c).
 3. INSTRUMENTS DOWN STREAM OF SOURCE VALVE TO BE SUPPLIED BY OTHERS.
 4. SI EL ÚLTIMO COMPRESOR SE ACTIVA, SE PRODUCIRÁ UNA ALARMA.
 5. TUBERÍA DE ADMISIÓN POR OTROS Y CUMPLIR CON LA ALARMA 3.1.1.1 (19)(c).
 6. ACCESORIOS INSTALADOS EN LA VALVULA DE CORTE DE SUMINISTRO, SE INSTALAN POR OTROS.

LEGEND (Leyenda)			
	AIR LINE (Tubera de Aire)		REGULATOR W/ GAUGE (Regulador con Manómetro)
	CONDENSATE LINE (Línea de condensado)		TEMPERATURE SWITCH (Interruptor temperature)
	FLEX HOSE (Manguera flexible)		PRESSURE SWITCH/TRANSDUCER (Interruptor/Transductor presión)
	UNION (Unión)		ELECTRIC AUTO DRAIN (Electroválvula de Drenaje)

	STREET LIGHTING TO INFORMATION 0.00 X 1.61 0.00 X 1.61	SOLID EDGE FINISHING 1/2" INCH (mm) THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION OF THE PROJECT WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. DATE: 07/16/25 7/16/1935 BY: [Signature]	NO SCALE DRAWING FOR DIMENSIONS SHEET 2 OF 2 SCALE 1:1 DATE: 07/16/25 PROJECT: Kumar Sreethan REVISIONS:	DESIGNED BY: [Signature] DATE: 07/16/25 REVISIONS: B D
---	--	---	--	---

POWERX[®]